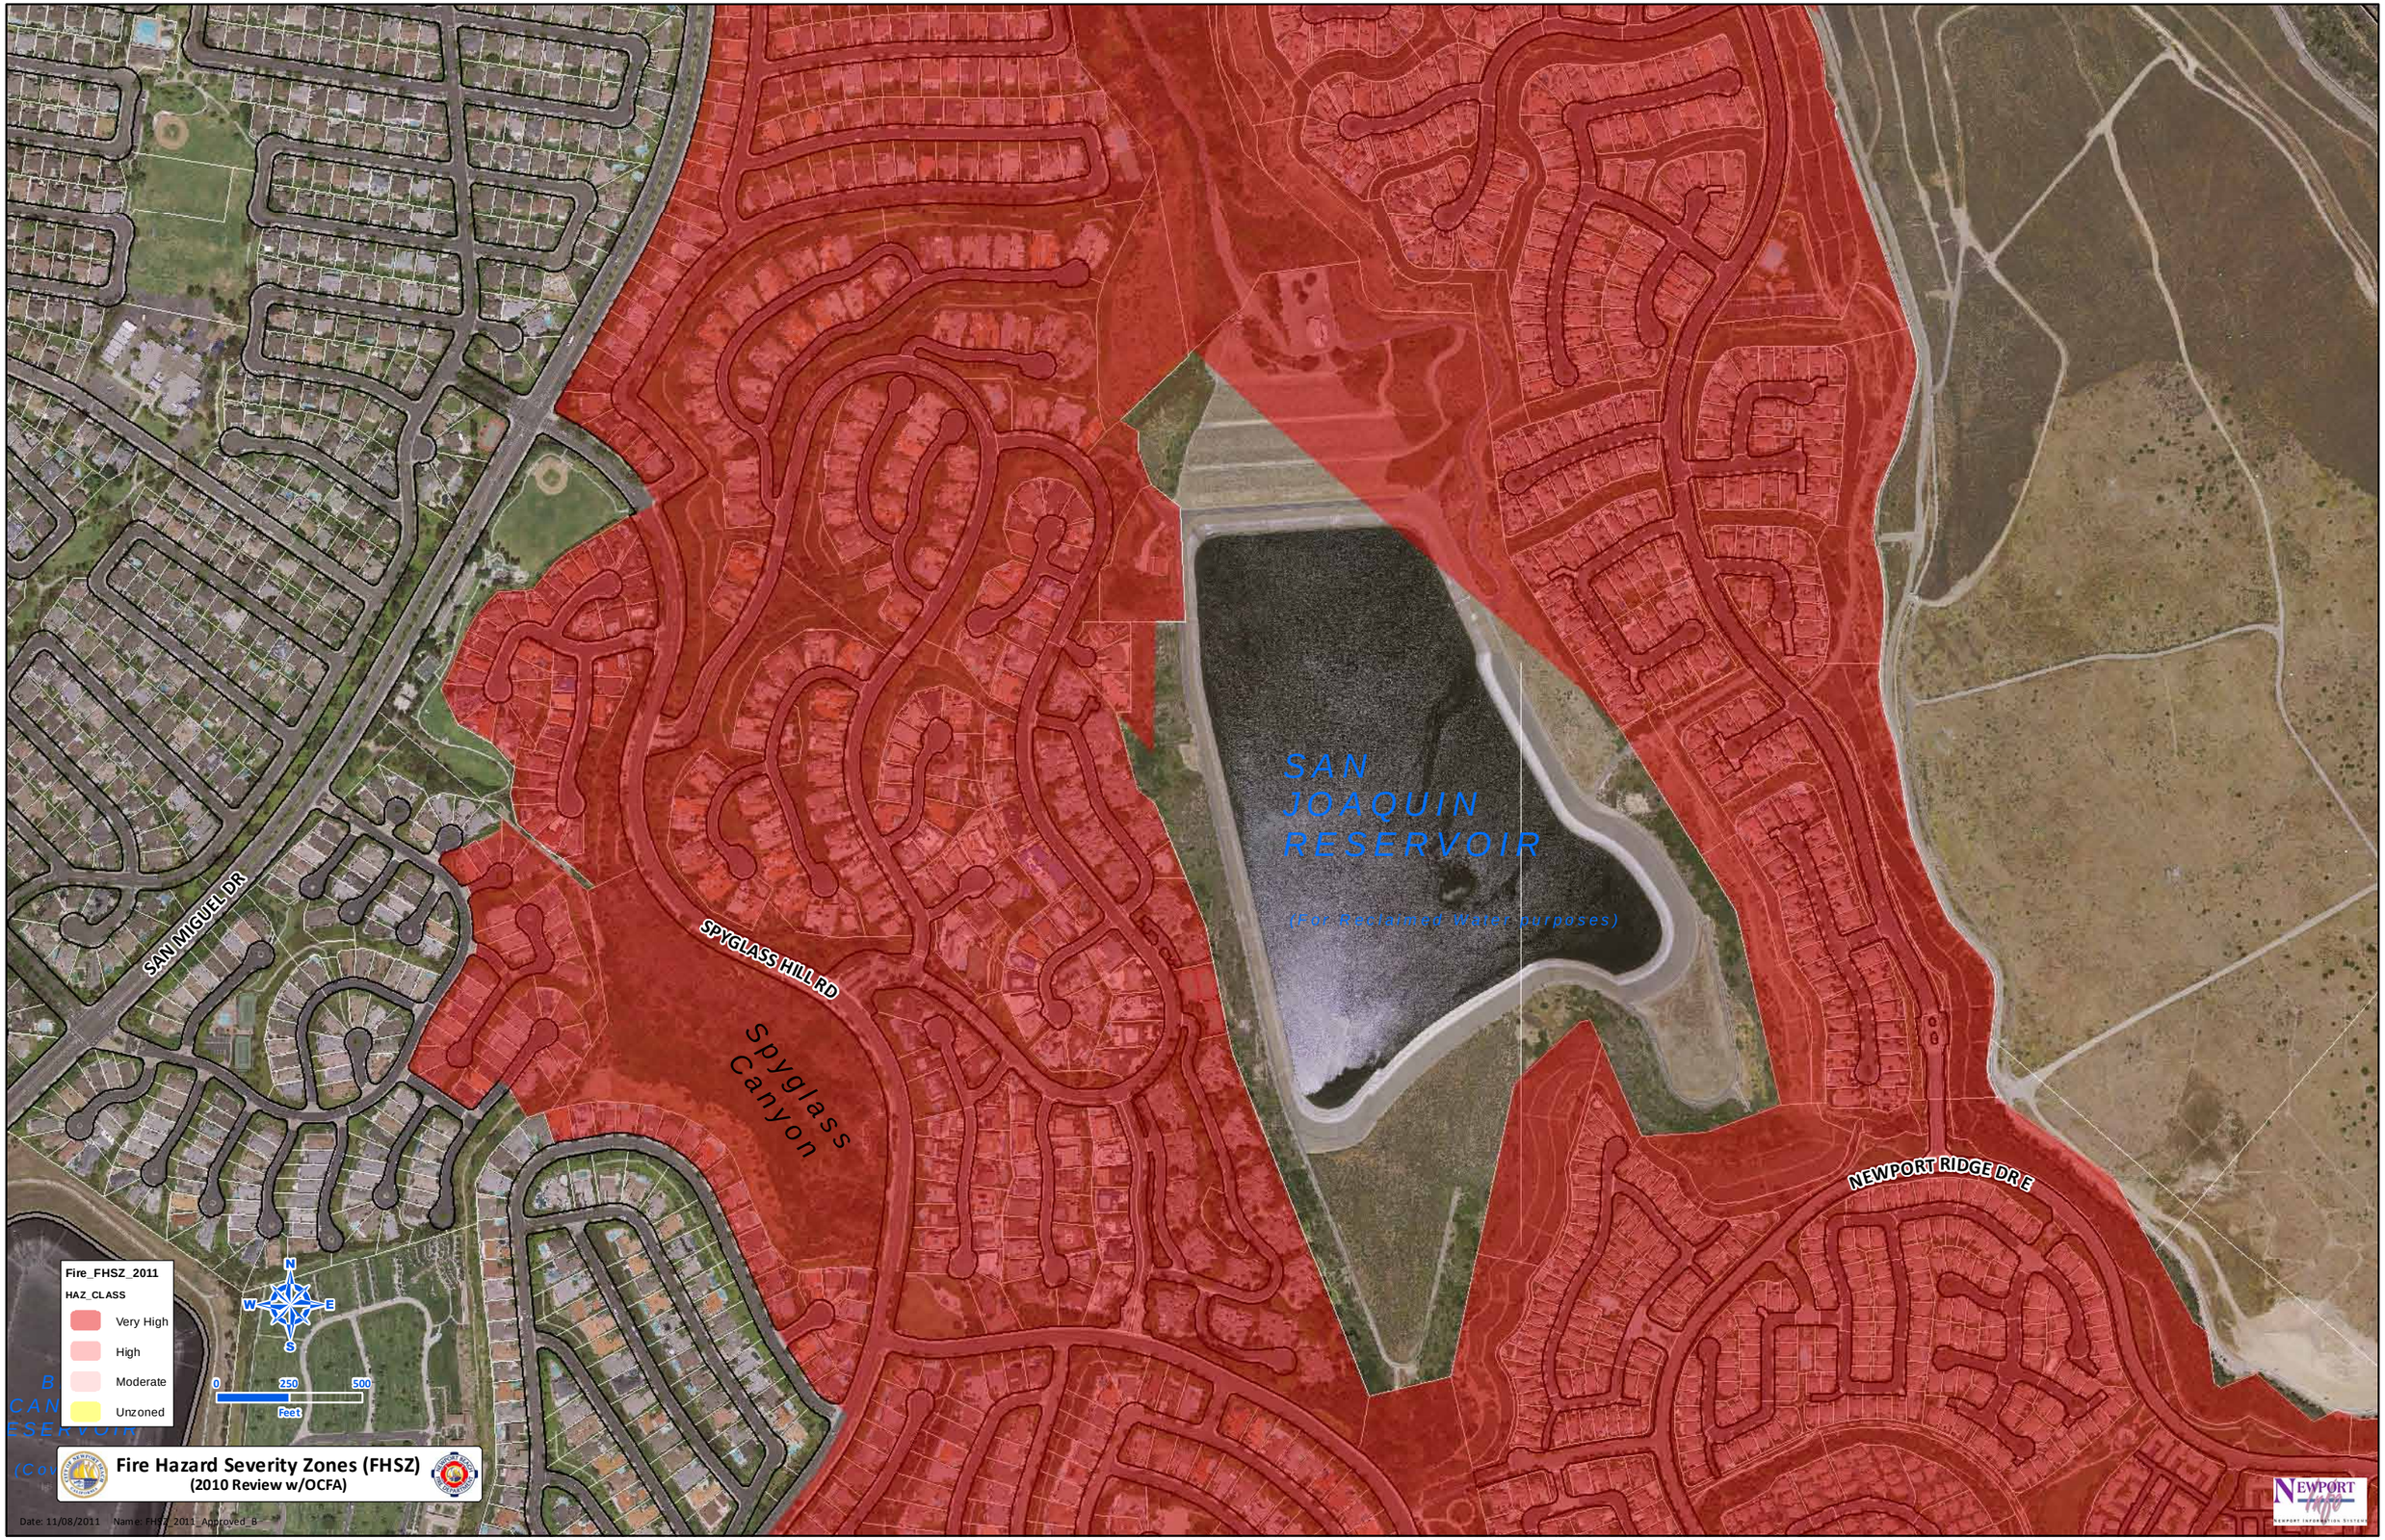
SAN JOAQUIN RESERVOIR
(For Reclaimed Water purposes)
SPYGLASS HILL RD
Spyglass Canyon
SAN MIGUEL DR
NEWPORT RIDGE DR E
Fire_FHSZ_2011
HAZ_CLASS
Very High
High
Moderate
Unzoned
N
W
E
S
0
250
500
Feet
Fire Hazard Severity Zones (FHSZ)
(2010 Review w/OCFA)
Date: 11/08/2011 Name: FHSZ_2011_Approved_B
NEWPORT