


SECTION B-B

SECTION A-A

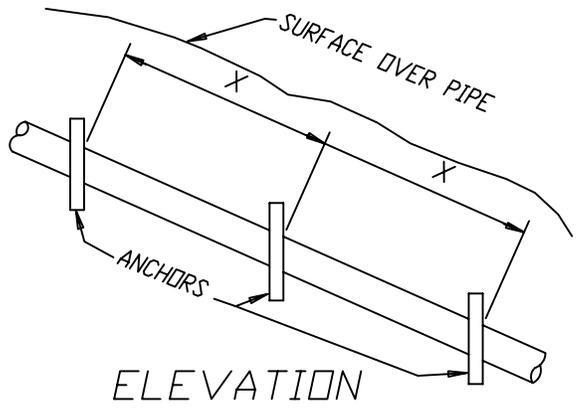

ELEVATION

PIPE SLOPE	X DISTANCE
1:1	12'
1-1/2:1	14'
2:1	16'
2-1/2:1	18'
3:1	20'

CONCRETE PIPE ANCHORS

NOTES:

1. PIPE ANCHORS REQUIRED ON ALL SLOPES OF 3:1 OR STEEPER.
2. ALL REINFORCING STEEL SHALL BE NUMBER 4 BARS.
3. *E* SHALL BE 8" UNLESS OTHERWISE SPECIFIED.

ADOPTED FROM L.A.C. STD. PLAN S-251-1

CITY OF NEWPORT BEACH
PUBLIC WORKS DEPARTMENT

APPROVED:

CONCRETE PIPE
SLOPE ANCHORS

DIRECTOR OF PUBLIC WORKS
R.C.E. NO. 12806

DATE	27 Sep 1993	SCALE	N.T.S.
DRAWN	M. GRACIA	STD-314-L	