

AMERON	
CAT. NO.	POLE HEIGHT
7-C2-10P	12'-3"
7-C2-13P	14'-6"
7-C2-14PS*	15'-6"


* SPECIFY 16" BOLT CENTER

INSTALL ANTI-SEIZE COMPOUND TO THREADS

LEVELING DETAIL


NOTES:

1. POLE HEIGHT AND WATTAGES TO BE SHOWN ON PLANS.
2. 2'-6" DIA. CIRCULAR FOUNDATION MAY BE USED IN PLACE OF 2'-0" FOUNDATION.
3. ALL BASES SHALL BE POURED TO 4" BELOW SIDEWALK GRADE, TO ALLOW FOR GROUT.
4. THE AREA AROUND ALL STANDARDS SHALL BE FORMED AND POURED WITH GROUT TO EXTEND 6" ON EACH SIDE AND BACK OF STANDARD AND FROM BACK OF CURB TO FRONT OF STANDARD. GROUT SHALL BE POURED FROM TOP OF BASE TO SIDEWALK GRADE. GROUT SHALL CONSIST OF 2 PARTS SAND AND 1 PART CEMENT.
5. EACH POLE SHALL HAVE A PULL BOX. SEE STD-204-L.
6. FUSE HOLDER IN ADJACENT PULL BOX, SEE STD-205-L.
7. ALL THREADED CONNECTIONS SHALL HAVE ANTI-SEIZE COMPOUND.
8. SEE POLE LEVELING DETAIL ABOVE.
9. FOR POLE WIRING, SEE CNB STD-205-L

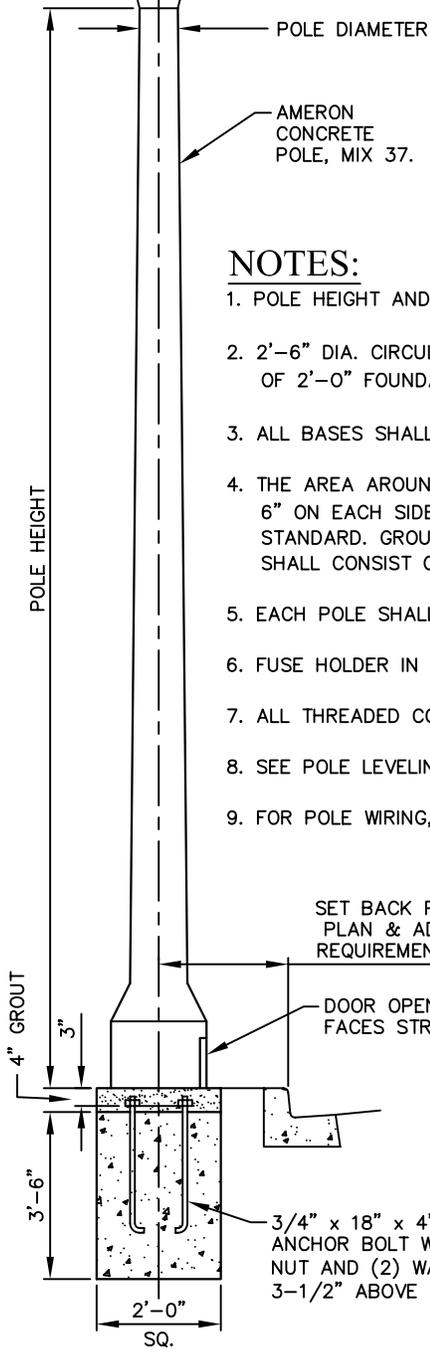

FOR 16' POLE
FOR 12' & 14' POLE

16" DIA. B.C. FOR 16' POLE
14-1/2" DIA. B.C. FOR 12' & 14' POLE

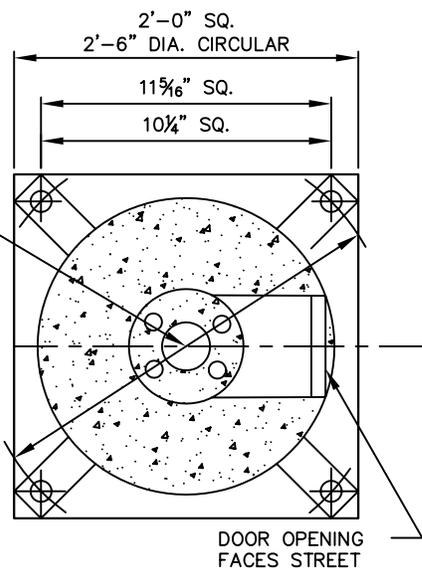

ELEVATION

BASE DETAIL

CITY OF NEWPORT BEACH
PUBLIC WORKS DEPARTMENT

LIGHTING STANDARD
TYPE III

APPROVED:

RCE NO. 36106

PUBLIC WORKS DIRECTOR

Drawn: M. Elias

Scale: N.T.S.

Date: Jan. 2004

F:\USERS\PBW\Shared\CAD\STD\STD Details\2003_Std\STD SCLight

DRAWING NO.

STD-202-L-B