

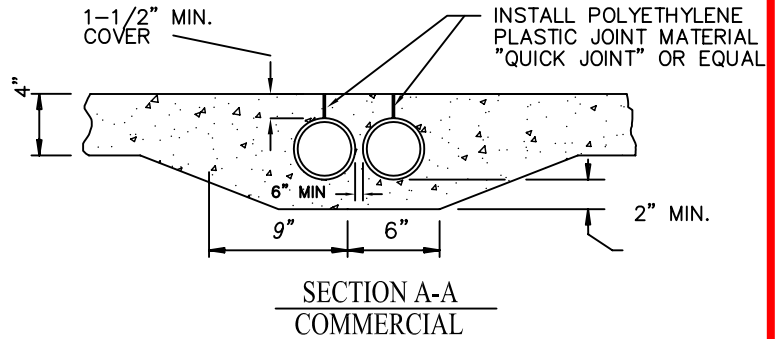


- 1- DRAINS WITH SLOPE GREATER THAN 10% MAY REQUIRE AN ENERGY REDUCER.
- 2- ALL DRAINS MUST BE INSTALLED 90° TO THE CURB FACE UNLESS APPROVED BY THE CONSTRUCTION ENGINEER.


ELEVATION

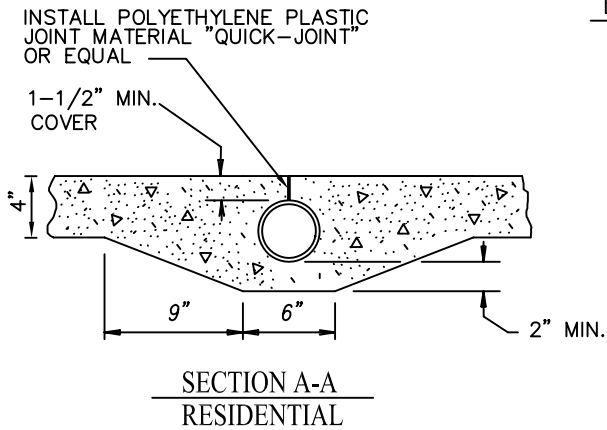


NOTE: IF CURB/GUTTER IS REMOVED JOIN TO THE NEAREST JOINT WITHIN TWO FEET.



DETAIL A

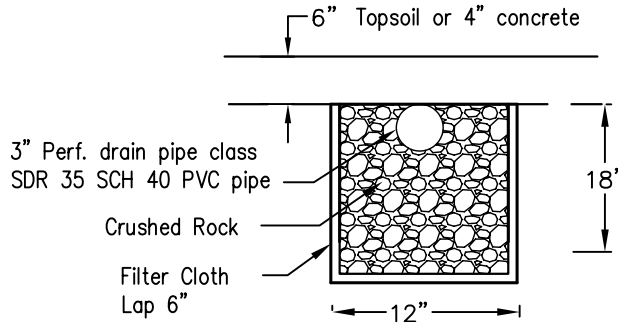

SECTION "B-B"

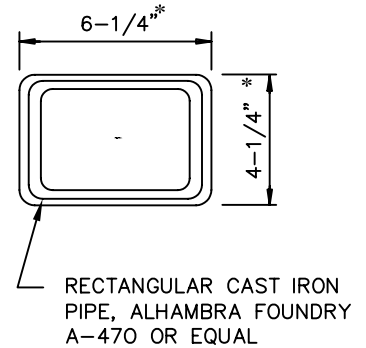

ALTERNATE
TO DETAIL A

DRAIN PIPE SECTIONS

* OUTSIDE HUB DIMENSIONS

CITY OF NEWPORT BEACH
PUBLIC WORKS DEPARTMENT

**PRIVATE DRAINS
THROUGH CURB**

APPROVED:

PUBLIC WORKS DIRECTOR

RCE NO. 36106

Drawn: P. Arciniega

Scale: N.T.S.

Date: June 2005/rev RO

F:\USERS\PBW\Share\CAD_PL\STD Details\2005_std

DRAWING NO.

STD-184-L